Sasha Power and Service Co Ltd

Selling all products from ABB, SIEMENS and Schneider

Location

- Mshikamano Kilimani
- Country: Tanzania, United Republic of
- County/ Region: Dar es Salaam Region

Business Information

- Industry: Manufacture of electrical equipment
- Sub Industry: Manufacture of electric electricity distribution and control apparatus
- Price Range: 0 - 0
- Opening Time (Mon - Friday): 07:00:00 - 20:30:00
- Saturday: 07:30:00 - 18:30:00
- Sunday: Closed

Contacts

- Phone Number: +255755875710
- Email Address: kihonzapengo@gmail.com
- Website:

Socials

- WhatsApp: +255676875710
- Facebook Page: Isaac Kihonza
- Instagram: @ABB PRODUCTS
- Twitter: @

Map

Photos

- 
ABB
E 203
100A
400V AC
AC-22A
IEC60947-3
1
3
5
2
4
6

- 
4000
Made in Egypt
- 

- 
OFF
ON
ABB
WSD463CL

- 
ABB
C 63
ABB

- 
ABB
ON
OFF
ISOLATE BEFORE REMOVING

- 
RTR
energía
MA/C/CE
5kVAr
Qn
A
Un
4,5 kVAr
6,8
380 V
5,0 kVAr
7,2
400 V
6,1 kVAr
8,0
440 V
-5 + 10%
3 / -KV
-25+55 °C
IEC 60831-1-2:2014
EN 60831-1-2:2014
Overpressure disconnector
Dry Type / Non PCB
Made in Spain
ABB

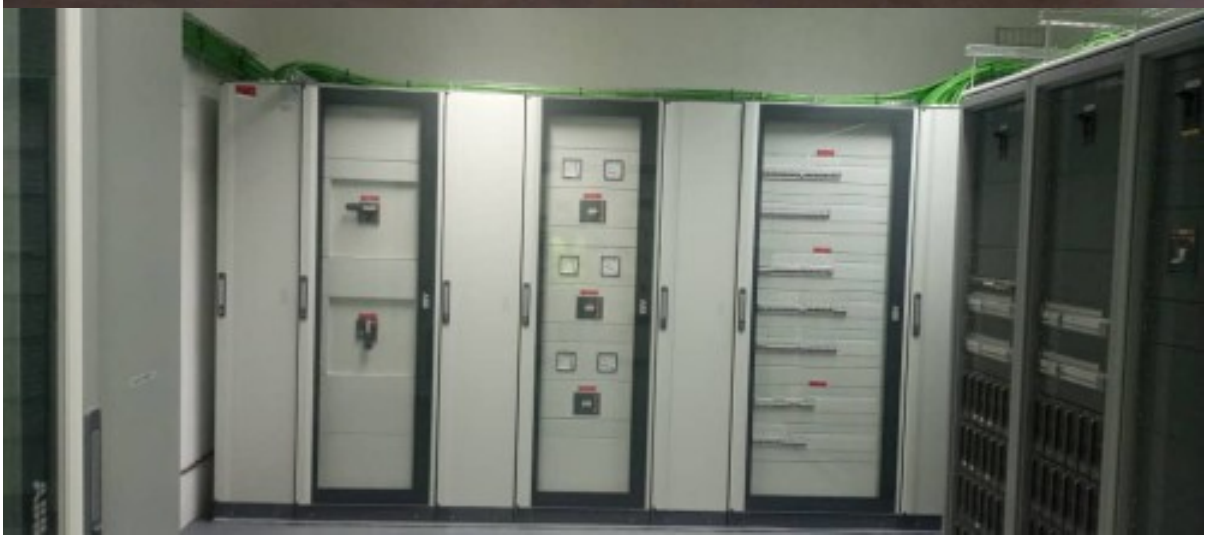
- 
ABB
ABB
ABB

- 

- 
ABB
ABB

- 
L1
L1
L2
L2
L3
L3
L4
L4

- 
L1
L2
L3
N
ABB
Neutral

- 
ABB
ABB
ABB
- 

- 

- 
- 

- 
SIEMENS
SIRIUS
Del -> Umin/Umax/
Asym delay
Mem ? -> Memory?
3UG4617-1CR20
- 

- 
ABB
DMTME-96
K
M
VL-L
VL-N
A
W
VAr
VA
PF
kWh
kVArh
L1
L2
L3
SETUP
MAX
MIN
V
A
Hz
W
VAr
VA
PF

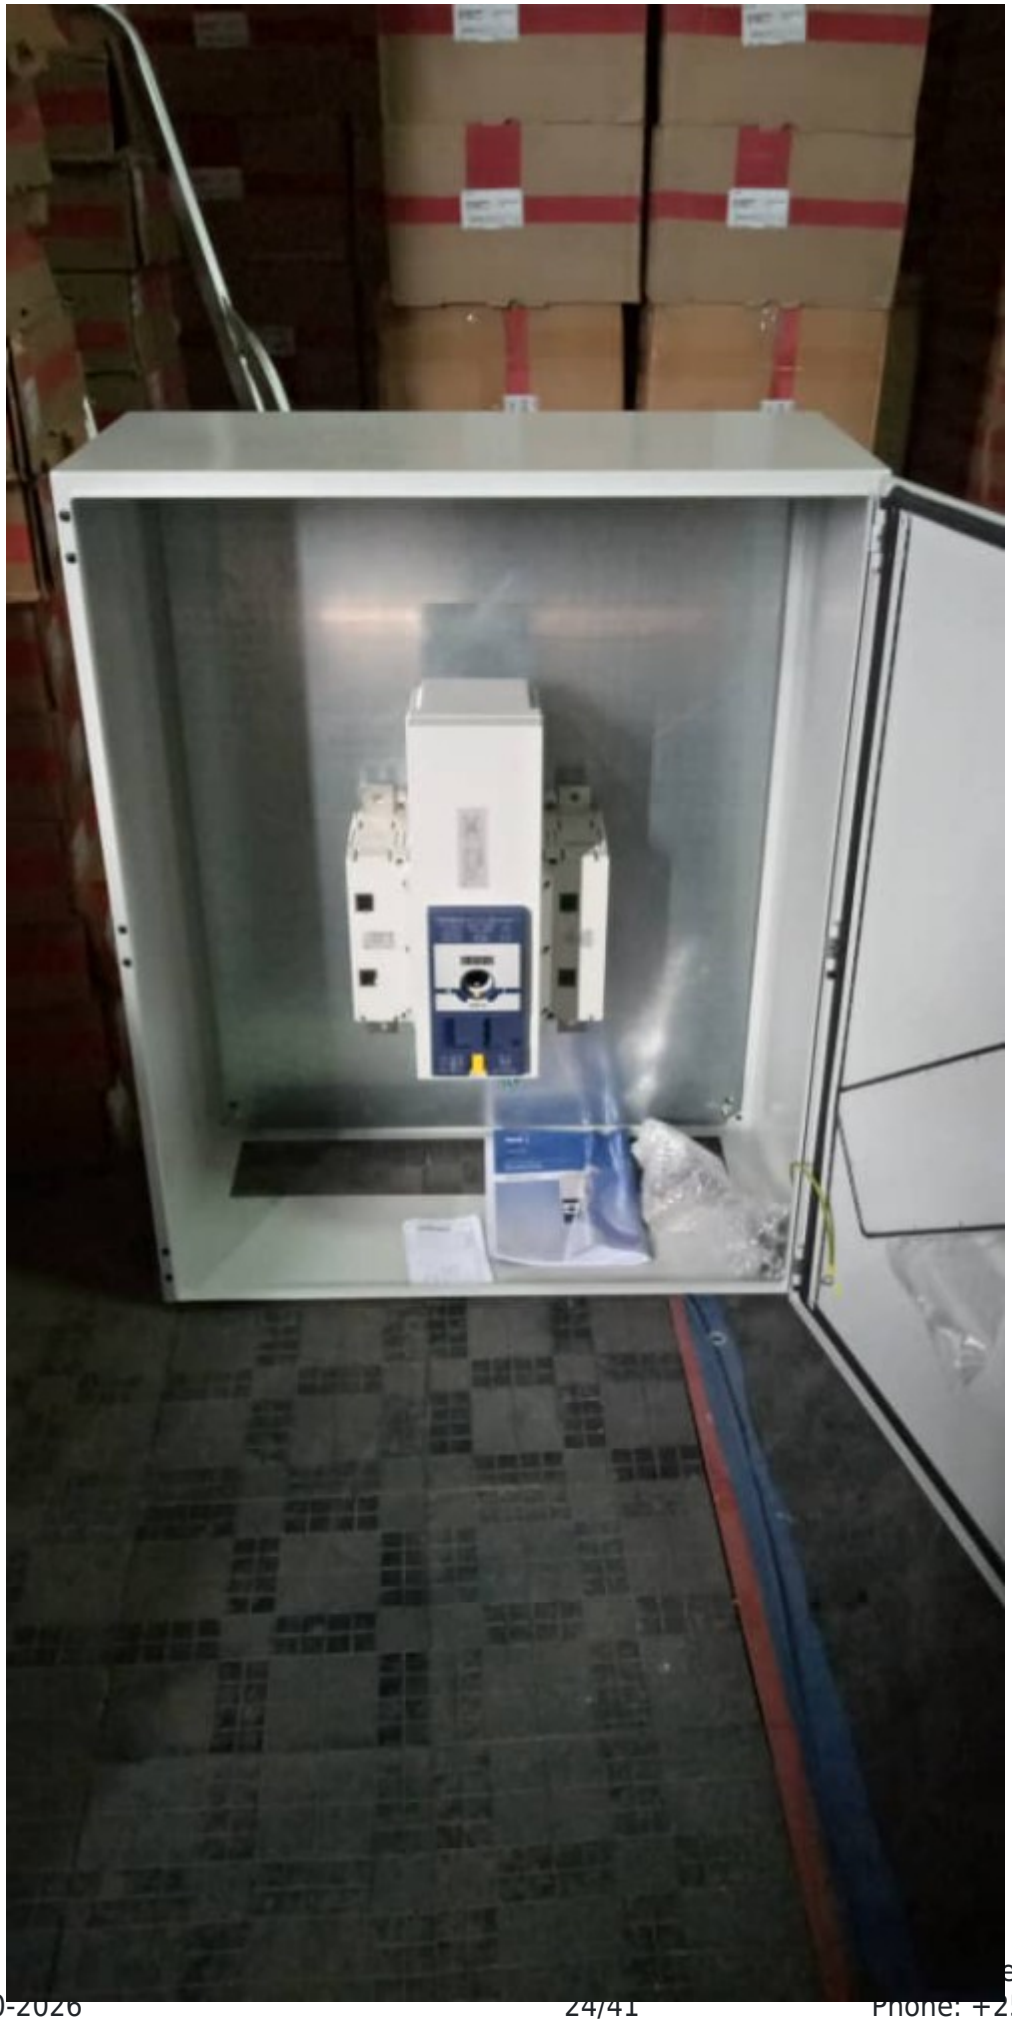
- 

- 
ABB
Made in Egypt
ON
OFF

- 

- 

- 

- 

- 

- 
- 

- 
SIEMENS
- 

- 
ABB
1L1
3L2
5L3
13NO
2T1
4T2
6T3
14NO
AF16-30-10-13
100-250V50/60HZ-DC
ABB
1L1
3L2
5L3
13NO
2T1
4T2
6T3
14NO
AF16-30-10-13
100-250V50/60HZ-DC

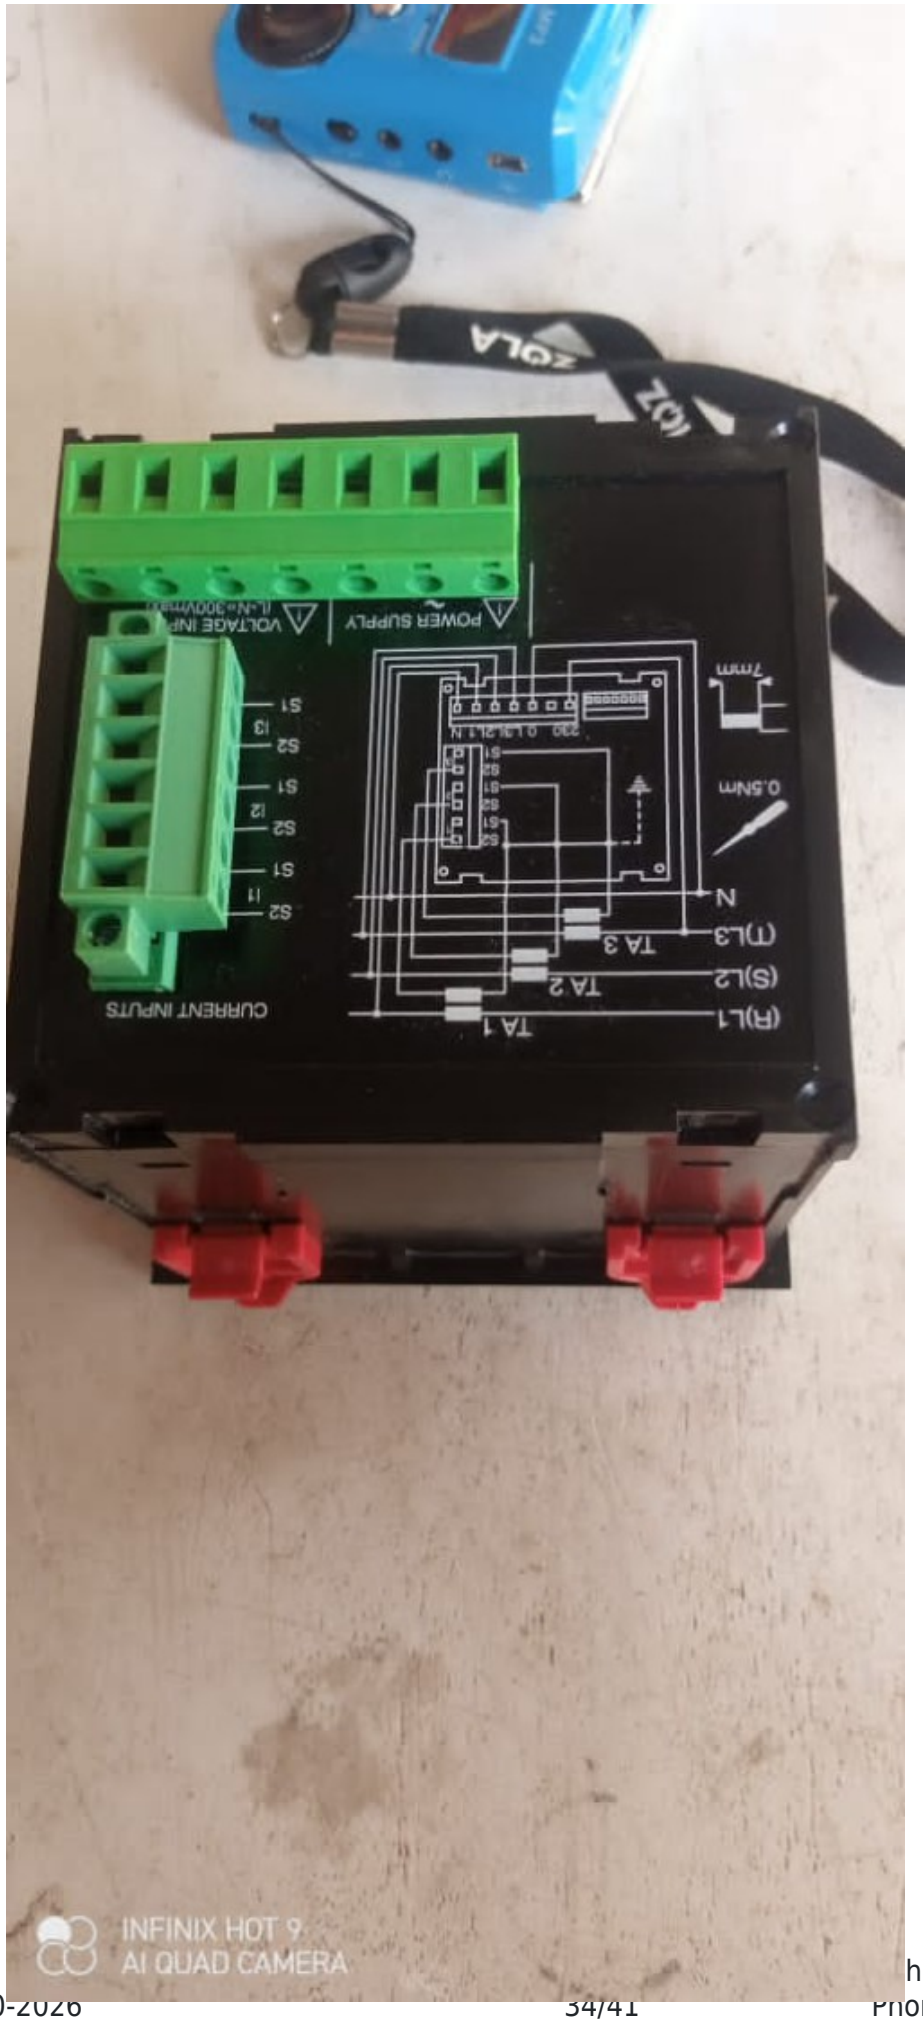
- 

- 

- 
N
TEST
ABB
FH204A
100A
Un=400V~
1000A
6000
1/2 3/4 5/6 7/8/N
2/1 4/3 6/5 8/7/N
E124I
2CSF204102R1100
N

- 
ABB
DMTME-96
K
M
VL-N
VL-L
A
W
VA
VAr
PF
kWh
kVArh
L1
L2
L3
SETUP
MAX
MIN
V
A
Hz
W
VAr
VA
PF
INFINIX HOT 9
AI QUAD CAMERA

- 
ABB

- 
POWER SUPPLY
CURRENT INPUTS
(R)L1
(S)L2
(T)L3
N
TA 1
TA 2
TA 3
0.5Nm
7mm
INFINIX HOT 9
AI QUAD CAMERA

- 

- 
- 
SIEMENS
- 
SIEMENS
SIRIUS
3UG4615-1CR20

- 
MS116
TEST
HKF1
-11
NC
NO

- 
P 101
DELTA
DPM-C520
HOME 16:49
VT 407.59 V
IT 324.80 A
PT 228.21 KW
ET 16660.290 KWh
SETUP PF PWR
PULSE FAULT
BACK
UP
DOWN
NEXT

- 

- 

- 

Generated from Nipate Hapa (nipatehapa.com). Visit us to get your own business listing.